

# Parliament of Australia

## SENATE

Submission on “**The social and economic impact of rural windfarms**”

Submission by

Bryan Leyland MSc, FIEE, FIMechE, FIPENZ.

The basis of my submission is that wind farms are seriously uneconomic compared to alternative forms of power generation and their contribution to reducing carbon dioxide is minimal.

### **Cost of wind generation**

The cost of wind generation is the sum of two separate costs. The first is the capital cost which must be amortised over the life of the wind farm – typically 20 years. The second is the cost of operation and maintenance which is an ongoing cost that increases towards the end of the life of the wind farm.

### **Cost Data**

Over the last few years, I have collected a database of costs of wind farms. The information comes from a variety of sources but, it seems, is as good as is available anywhere. Over the last two or three years, there has been less publicly available information on the cost of wind farms. I assume that this is because the cost has not been declining. If the cost had been declining, I am sure that it would have been the subject of much publicity.

The costs are in a number of currencies and I converted them to US dollars and then to Australian dollars. The overall cost is calculated as a simple average cost. To make sure that this was not misleading because of the small size of some of the windfarms, I also calculated the average cost based on a weighting of cost in proportion to the output of the wind farm. There was virtually no difference between the two.

### **Operation and maintenance costs**

Information on this hard to obtain. For the purpose of the study, I have relied on the report produced by PB Power for the Electricity Commission in New Zealand. I have used this information in a number of submissions against wind farm installations in New Zealand and it has never been challenged by the promoters of the wind farm. I therefore assume that it is either on the low side or more or less correct.

### **Calculation**

The cost of generation has been calculated using a spreadsheet. For the purposes of illustration I have chosen a windfarm installation of 100 MW costed at AU\$2400/kW. The input data to the spreadsheet are the capital cost spread over a two-year construction period and the operation and maintenance costs spread over time. The expected income from the station is calculated based on a capacity factor of 30% and a constant sale price. The spreadsheet is based on real 2011 costs and therefore inflation is not needed to be taken into account. The spreadsheet calculates the present value of the costs for a given discount rate. (I have used discount rates of 10% and 8%) and to complete the calculation I adjusted the electricity price until a net present value was zero. This then gave the discounted cost of generation for the associated discount rate.

Below is a copy of the data base and a copy of the calculations for a 10% discount rate.

Name of windfarm	source of information	date	Output in MW	cost	Cost/kW	currency	contract or estimated	exchange rate to \$US 14 Jan 09	Cost in dollars US/kW	Adjustment for local costs (+15%)	Total Cost \$US/kW	Cost in Australian dollars at 0.98
<b>Onshore windfarms</b>												
Lynmouth, UK	ScottishPower	Jan 12, 2009	30	35 million	1,167	GBP	estimate 2006	1.452	\$1,694		1,694	1,729
St. Nikolas Wind Farm Bulgaria	Energy Central	Dec 16, 2008	156	270 million	1,731	Euro	contract 2008	1.319	\$2,283		2,283	2,329
Pampa/Mesa Power Texas	Energy Central	Dec 9, 2008	1,001	2 billion	1,999	USD	estimate 2008	1	\$1,999		1,999	2,040
Alto Minho, Portugal	Energy Central	Nov 26, 2008	240	360 million	1,500	Euro	contract 2008	1.319	\$1,979		1,979	2,019
Saxony Anhalt, Germany	Energy Central	Nov 18, 2008	55	81 million	1,473	Euro	sale price	1.319	\$1,943		1,943	1,982
Puerto Rico	Energy Central	Oct 20, 2008	50	165 million	3,300	USD	contract price (9.12 c/kWh)	1	\$3,300		3,300	3,367
Tatanka ND, USA	Energy Central	Sep 15, 2008	180	381 million	2,117	Euro	Contract 2008	1	\$2,117		2,117	2,160
Totoral, Chile	Energy Central	Jun 27, 2008	46	140 million	3,043	Euro	Contract 2008	1	\$3,043		3,043	3,106
Areloch, UK	Energy Central	Jun 26, 2008	180	200 million	1,111	GBP	estimate 2008	1.452	\$1,613		1,613	1,646
Karnice/ Dong, Poland	Energy Central	Jun 24, 2008	30	443 million	14,767	DKrone	contract	0.177	\$2,614		2,614	2,667
New Richmond/St Valentine, Quebec	Energy Central	Apr 30, 2008	66	190 million	2,879	USD	estimate 2008	1	\$2,879		2,879	2,938
Hallett, South Australia	Energy Central	Jun 13, 2008	95	236 million	2,484	SAU	contract 2008	0.679	\$1,687		1,687	1,721
Ashtabula, Barnes Co, North Dakota	Energy Central	Apr 30, 2008	48	121 million	2,521	USD	contract 2008	1	\$2,521		2,521	2,572
Suwalko/Tycho, Poland	Energy Central	Apr 21, 2008	76	100 million	1,316	Euro	generating plant only	1.319	\$1,736	260.3	1,996	2,037
Biglow Canyon	Energy Central	Apr 3, 2008	625	1.1 billion	1,760	USD	generating plant only	1.319	\$2,321	348.2	2,670	2,724
Lissett aerodrome UK 28% cf	Energy Central	Feb 18, 2009	30	38.5 million	1,283	GBP	Completed price	1.452	\$1,863		1,863	1,901
Project Hayes, NZ	RMA hearing	Feb 1, 2009	630	2 billion	3,175	SNZ	Estimate before completion	0.75	\$2,381		2,381	2,430
Makara, Wellington	News report	May 1, 2009	143	440 million	3,086	NZD	Estimate before completion	0.75	\$2,314		2,314	2,361
Juhl Wind, Winona	Energy central	Oct 8, 2010	1.5	3.6 Million	2,400	USD	Estimate before completion	1	\$2,400		2,400	2,449
Vinalhaven, Maine	NY times	Oct 5, 2010	4.5	15 Million	3,333	USD	Final cost?	1	\$3,333		3,333	3,401
Milli Creek New Zealand	Dr Layton Eviden	Jul 20 2010	71.3	209.4 million	2,937	NZD	Estimate before completion	0.75	\$2,203		2,203	2,248
Turkey Hill USA	Energy Central	Dec 29, 2010	3.2	9.5 million	2,969	USD	Final cost	1	\$2,969		2,969	3,029
<b>Average costs</b>											<b>\$ 2,355</b>	<b>\$ 2,403</b>
<b>Offshore windfarms</b>												
Gwynt y mor offshore	Daily Post, Live	Dec 30, 2008	750	2.2 billion	2,933	GBP	estimate 2008	1.452	\$4,259		4,259	4,346
Robin Rigg Wind Farm Offshore	Reuters	Dec 19, 2008	180	325 million	1,806	GBP	Contract 2008	1.452	\$2,622		2,622	2,675
Atlantic array, offshore, UK	Energy Tribune	Apr 2, 2008	1,500	6,000 million	4,000	USD	estimate 2008	1	\$4,000		4,000	4,082
Greaterm Gabbard,offshore, UK	Energy Central	May 15 2008	504	800 million	1,587	Euro	generating plant only	1.319	\$2,094	314.0	2,408	2,457
London Array, UK offshore	Energy Central	May 1, 2008	1,000	2 billion	2,000	GBP	estimate 2008	1.452	\$2,904		2,904	2,963
Thanet Wind farm UK offshore	Daily Mail	Sep 23, 2010	300	780 million	2,600	GBP	Published final? cost	1.319	\$3,429	0	3,429	3,499
<b>Average costs</b>											<b>\$ 3,270</b>	<b>\$ 3,337</b>

Description	Year	-1	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
O&M cost \$A/kW				32.3	32.3	32.3	32.3	32.3	25.4	25.4	25.4	25.4	25.4	25.4	25.4	46.2	46.2	46.2	46.2	46.2	46.2	46.2	46.2
Capital costs \$m for a nominal 100 MW	2.4 \$/MW	72	240																				
O&M costs \$m @ 1.25 c/kWh				3.2	4.6	4.6	4.6	4.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	6.6	6.6	6.6	6.6	6.6	6.6	6.6	6.6
Income from generation \$m @ 263 GWh	263	16 c/kWh		42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0	42.0
Cash flow \$m				38.8	37.4	37.4	37.4	37.4	38.4	38.4	38.4	38.4	38.4	38.4	38.4	35.4	35.4	35.4	35.4	35.4	35.4	35.4	35.4
IRR		10.01%		<b>Costs at station gate</b>																			
Discount rate		10.00%		<b>At 10% cost is 16c</b>																			
NPV 20 yrs		\$0.25 \$m		<b>At 8% cost is 14 c</b>																			

The spreadsheet shows that, under the given assumptions, the cost with a 10% discount rate is 16c/kWh and, for an 8% discount rate, 14c/kWh. I should make it clear that this is the cost at the station gate and it makes no allowance for transmission costs and system support costs.

### Reduction in carbon dioxide emissions

Because, in Australia, the wind tends to drop around the middle of the day, the amount of windpower provided during a system peak demand period in the summertime is quite small. Probably 5% or less. Because windpower is intermittent and cannot be predicted more than a few hours ahead, the system operator will always have to ensure that adequate capacity is available during a system peak demand even if windpower is 5% or less. What this means is that any contribution that wind makes to reducing coal-fired electricity generation is valued at the marginal cost of generation. For a coal fired station, this is 2-4 c/kWh. (By “marginal cost” I mean the cost of fuel and operation and maintenance.)

In fact, the situation is somewhat worse than this. Because most of the power in Australia is provided by coal-fired power stations that cannot change load rapidly in response to a rapid change in wind farm output, it will be necessary to build a number of open cycle gas turbine stations. These will be paid for by the consumer, not the owners of the windfarms. Apart from pumped storage hydropower, these are the only units capable of rapidly responding to a change in wind generation. These open cycle gas turbines are relatively expensive (more than \$1000/kW) and they are also quite inefficient.

Even with these gas turbines, coal-fired stations will have to change load more often than previously and, quite often, they will be operating at partial load or even quite small loads. Such operation is inefficient and, as a result, the carbon dioxide released from coal-fired

power generation is not likely to be reduced by a large amount despite a relatively large amount of wind power.

In a paper entitled: “Cost and Quantity of Greenhouse Gas Emissions Avoided by Wind Generation” Peter Lang calculated that windpower reduces carbon dioxide emissions by about 0.5 kG/kWh. Carbon dioxide emissions from coal-fired power stations in Australia are higher than this and can be as high as 1 kg/kWh.

His main conclusions were:

1. *Wind power does not avoid significant amounts of greenhouse gas emissions.*
2. *Wind power is a very high cost way to avoid greenhouse gas emissions.*
3. *Wind power, even with high capacity penetration, cannot make a significant contribution to reducing greenhouse gas emissions.*

A copy of the paper is attached to this submission. Please note that his cost estimates for wind power are different from mine and, it would appear, are based on much earlier information. With my higher costs, the picture is even worse.

### **Conclusions**

The evidence I have presented here shows that wind power is an unusually expensive way of generating electricity, it does not provide any reliable contribution over system peak demands and that, as a way of avoiding carbon dioxide emissions, it is both expensive and relatively ineffective.

Carbon dioxide emissions can be reduced much more cheaply by moving towards higher efficiency coal fired plant, by switching from coal to gas-fired combined cycle and, of course, by the use of nuclear power. All of these would produce a larger amount of emissions reduction at a much lower cost.

My final conclusion is that there is absolutely no reason to continue subsidising wind power in the name of making a substantial reduction in carbon dioxide emissions. I would point out that, all over the world, windpower is heavily subsidised. Without these subsidies, windpower (and solar power) would not even exist.

# **Cost and Quantity of Greenhouse Gas Emissions Avoided by Wind Generation**

**By**

**Peter Lang**

This paper contains a simple analysis of the amount of greenhouse gas emissions avoided by wind power and the cost per tonne of emissions avoided. It puts these figures in context by comparing them with some other ways of reducing greenhouse gas emissions from electricity generation.

The conclusion: wind farms connected to the National Grid provide low value energy at high cost, and avoid little greenhouse gas emissions.

The paper covers the following:

1. Background
2. Electricity generation cost per MW/h
3. Greenhouse gas emissions per MWh
4. Emissions avoided per MWh
5. Cost of emissions avoided per MWh
6. Comparison with other options to reduce emissions from electricity generation
7. Discussions
8. Conclusions
9. References
10. About the Author


## ***Background***

Wind power is intermittent, so either energy storage or constantly, instantly available back-up generation is required to provide constant power.


Wind power is proportional to the cube of the wind speed. So a small drop in wind speed causes a large drop in the power output. For a modern 2.1 MW wind turbine a 2 m/s drop in wind speed from 9 to 7 m/s halves the power output.

The wind speed is very variable. Figures 1 and 2 give examples of how variable it is.

**Figure 1 – The variability of wind power**

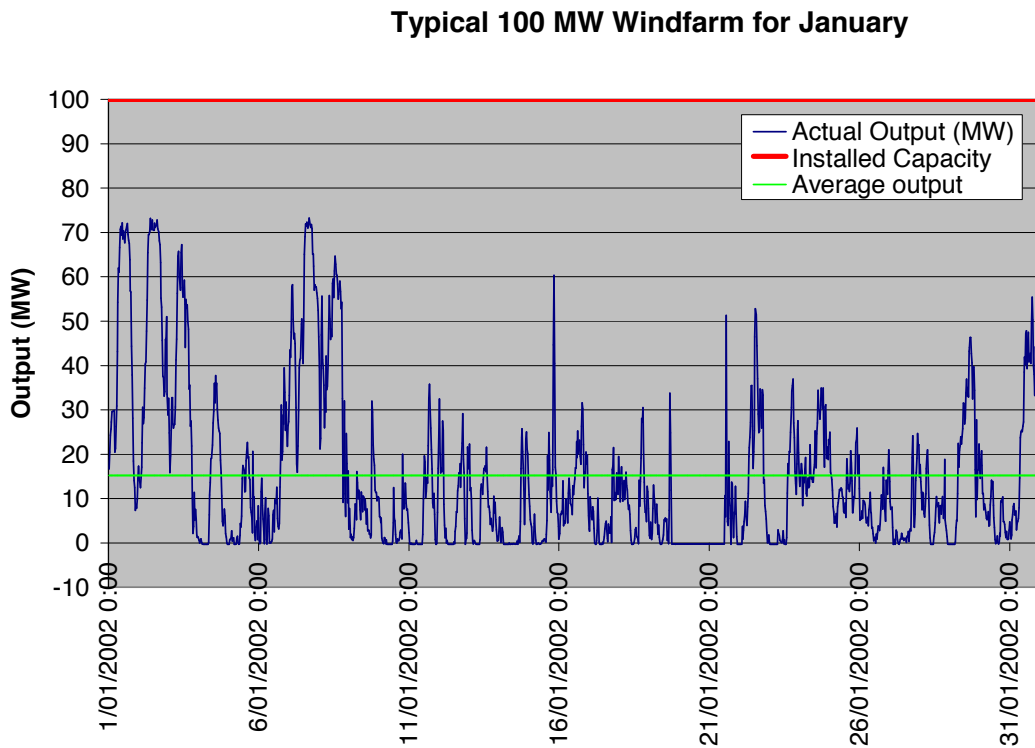

**Figure 2 – the variability of wind power**

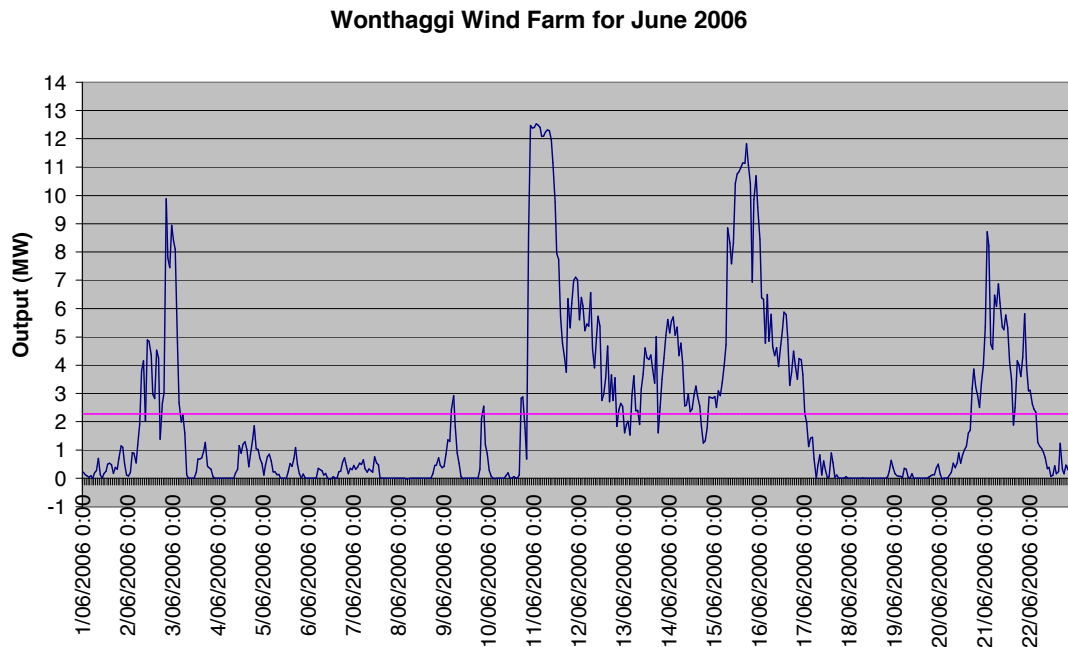

Energy storage<sup>1</sup> is completely uneconomic for the amounts of energy required. So we must use back-up generation.

Constantly, instantly available back-up must be provided by reliable energy sources (to provide power whenever the wind speed drops). Coal, gas, hydro and nuclear power provide reliable power, but not all are suitable as back up generators for wind power.

Back-up generation is mostly provided by gas turbines in Australia. The reasons why gas provides the back-up rather than one of the other energy sources are:

1. We have insufficient hydro resources to provide peak power let alone provide back-up for wind power. Hydro energy has high value for providing peak power and for providing rapid and controllable responses to changes in electricity demand across the network. So our very limited hydro resource is used to generate this high value power.
2. Coal generates the lowest cost electricity and, therefore, coal generation is the last to be displaced when a new source of electricity becomes available (such as when the wind blows). That is, when wind energy is available it displaces the highest cost generator first. Coal is displaced last.
3. Coal generators cannot follow load changes rapidly. Brown coal power stations (as used in Victoria) are designed to run at full power all the time. They can only reduce power by venting steam, but they continue to burn the same amount of coal and hence produce the same amount of emissions whether or not they are generating electricity. Black coal power stations have some limited capability to follow the load but cannot follow the rapid changes in wind power.
4. Gas turbines can follow load changes fairly well but not as rapidly as the wind power changes. Gas turbines power up and down like a turbo-prop aircraft engine, but with slower response. Next to hydro, gas turbines are best able to follow the load changes created by wind power.
5. There are two classes of gas turbine: Open Cycle Gas Turbine (OCGT) and Combined Cycle Gas Turbine (CCGT). OCGT has lower capital cost, higher operating costs, uses more gas and produces more greenhouse emissions than CCGT per MWh of electricity generated. OCGT follows load changes better than CCGT. OCGT produces electricity at less cost than CCGT at capacity factors less than about 15% (ie 15% of the energy it would produce if running full time at full power). CCGT has higher capital cost and needs to run at higher power and run for longer to be economic. CCGT is more efficient so it uses less gas and produces less greenhouse emissions. CCGT produces electricity at less cost than OCGT for capacity factors above about 15%. (See figure 3).


---

<sup>1</sup> <http://www.greenhouse.gov.au/renewable/aest/pubs/aest-review.pdf> , Fig 13, p28

**Figure 3**

Source: “Long Run Marginal Cost of Electricity Generation in NSW, A report to the Independent Pricing and Regulatory Tribunal, Feb 2004”

**Exhibit 1-2 Medium New Entry Cost Scenario as a Function of Capacity Factor (Medium Scenario)**

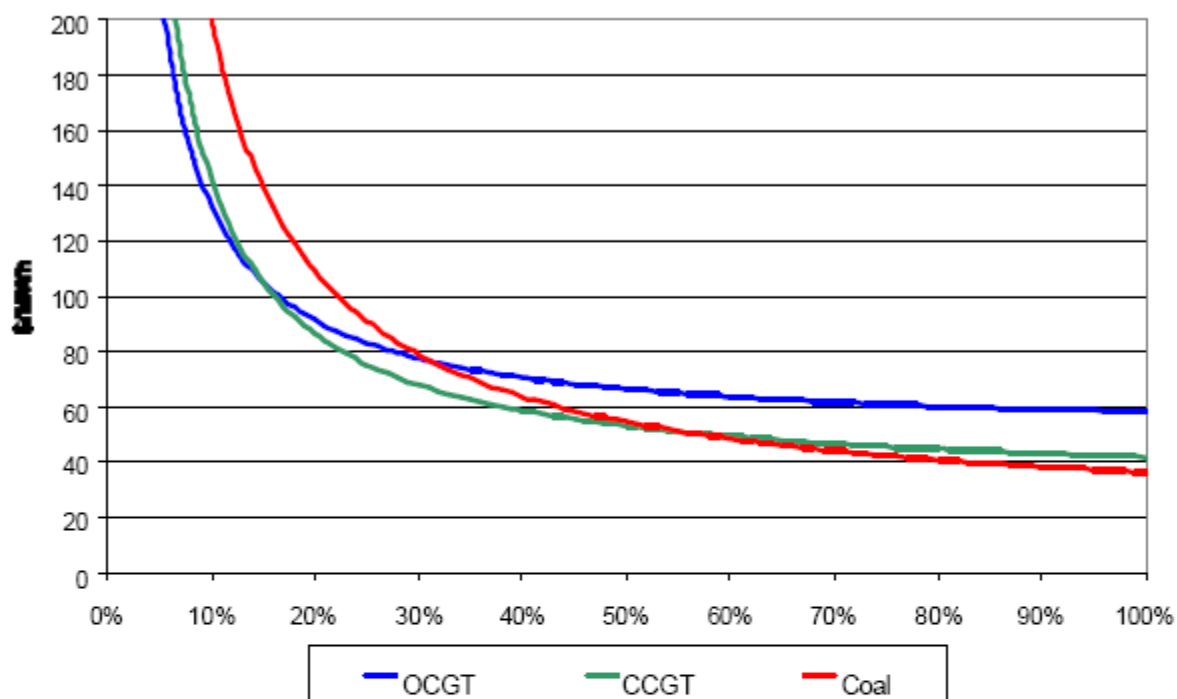

The study noted the cross over points in the cost versus capacity factor characteristic. These cross over points represent the capacity factors where one technology becomes more economic than the next. The optimal capacity factors and the corresponding new entry costs for each technology are shown in Exhibit 1-3 below.

**Exhibit 1-3 Optimal Capacity Factors and Associated New Entry Cost (Medium Scenario)**

	Thermal Coal	CCGT	OCGT
CF	100%	55%	14%
New Entry Cost	\$36.2/MWh	\$50.9/MWh	\$109.0/MWh

6. The ideal arrangement (grossly simplified) is:
  - a. Coal (and/or nuclear) generates base load power (24 hours per day);
  - b. CCGT generates shoulder power (approximately 12 hours per day, but variable duration);

- c. OCGT generates shoulder and peak power and follows the load changes (average less than 15% capacity factor);
  - d. Hydro generates peak power and provides stability to the grid.
7. If wind generation is available the power produced is highly variable and unscheduled so it needs to be backed up by OCGT. Although OCGT is called up to back up for wind, the energy produced by wind actually displaces CCGT generation mostly (see next section for explanation).
  8. Because wind energy is variable, unreliable and cannot be called up on demand, especially at the time of peak demand, wind power has low value.
  9. Because wind cannot be called up on demand, especially at the time of peak demand, installed wind generation capacity does not reduce the amount of installed conventional generating capacity required. So wind cannot contribute to reducing the capital investment in generating plant. Wind is simply an additional capital investment.

## The Basis for Comparison

Wind generation displaces CCGT mostly. If we did not have wind power, CCGT would be the most economical and least greenhouse intensive way to generate shoulder power (non-continuous power). To explain, consider the following.

If governments did not mandate and subsidise wind power (by Mandatory Renewable Energy Targets and State based regulations and subsidies) then CCGT and OCGT would be installed in the optimum proportions to provide shoulder and peak generation (in excess of available hydro energy).

If governments mandate wind power then we will need more OCGT and less CCGT than without wind power. The substitution of OCGT for CCGT is (nearly) in proportion to the amount of wind capacity installed, not the amount of wind energy that will be generated. The reason is that the OCGT is required to back up for most of the wind power's maximum capacity, not for its average energy production. For example, if we install 100 MW of wind power, nearly 100 MW of OCGT must be installed instead of 100 MW of CCGT. (For more detailed explanation see "Security Assessment of Future UK Electricity Scenarios"<sup>2</sup>).

To estimate the cost of, and greenhouse emissions avoided by, wind generation we need to compare CCGT versus wind generation plus OCGT back-up.

---

<sup>2</sup> [http://www.tyndall.ac.uk/research/theme2/final\\_reports/t2\\_24.pdf](http://www.tyndall.ac.uk/research/theme2/final_reports/t2_24.pdf)



## **Electricity Generation Cost per MW/h**

The cost of electricity generation by gas turbines for various capacity factors<sup>3</sup> is listed below:

CF	Generation Cost (\$/MWh)	
	OCGT	CCGT
100%	60	40
45%	70	54
30%	78	67
15%	105	100

The cost of wind generation at 30% capacity factor is about \$90/MWh (this figure does not include the cost of back-up). The figure is derived from the proponent's case to the NSW Land and Environment Court for a Wind Farm at Taralga, from ESAA<sup>4</sup>, and from actual costs for wind generation in South Australia and New Zealand.

## **Cost of Back up Generation for Wind**

The figure of \$90/MWh for wind does not include the cost of back up, nor the cost imposed on the generators, the grid, and distributors caused by the variable and unreliable power. Some of the costs not included in the figure for wind power are:

1. The cost of the investment in generator capacity required to meet peak demand. Nearly the full amount of fossil fuel and hydro generating capacity must be maintained to meet peak demand. The investment in wind displaces almost no capital investment in conventional generating plant.
2. The fossil fuel generators must charge a higher price for their electricity to recoup the fixed costs of their plant over a lesser amount of electricity supplied (ie as they power down when the wind blows)
3. The cost of maintaining 'spinning reserve' - keeping the generators running ready to power up as soon as the wind speed drops. The costs are: fuel, operation and maintenance, and return on capital invested.
4. The cost of fuel for powering up each time the wind changes.
5. Higher gas costs. Most of the gas price is in the pipes, not the price of the gas at the well head. The gas supply pipes need to be sized to run the gas turbines at full power. When the OCGT is operating as back-up for wind it produces less power than optimum. The fixed cost of the gas pipes is spread over less MWh generated by the gas turbine. So the cost of gas and hence the cost of electricity generated must be higher to give an economic return for the generator.

---

<sup>3</sup> "Long Run Marginal Cost of Electricity Generation in NSW; A report to the Independent Pricing and Regulatory Tribunal, Feb 2004", Exhibit 1.2.

<sup>4</sup> <http://www.esaa.com.au/images/stories//energyandemissionsstudystage2.pdf>

6. High-value, hydro-energy is wasted. With wind power connected to the grid extra hydro energy (some of it pumped to storage by coal fired plants during off-peak hours) has to be used to stabilise the grid, to provide fast response power when the OCGTs cannot power up fast enough, and to maintain a greater amount of spinning reserve. The rapid changes in wind power causes instability in the network. Some wind changes occur faster than the OCGT's can ramp up. Fast response hydro energy, from our limited reserves, is used to balance these load fluctuations.
7. The grid must be stronger to accommodate the greater variability imposed by the wind generators.
8. There are higher operational costs for the grid operators and distributors. For example, each distributor has a group dedicated to ensure the distributor buys enough renewable energy to meet its government mandated obligations. The full additional cost is millions of dollars per year and this is passed on to consumers in a higher price of electricity.

Assume that the cost of maintaining back up for wind generation is 50% of the cost of generating with the OCGT (i.e., \$39/MWh based on the preceding figures and assumptions). Now we can calculate a cost of having wind power in the generation mix.

Option 1 – No Wind. CCGT generates 45% capacity factor – Cost: \$54/MWh

Option 2 – Wind plus OCGT generates 45% capacity factor - Cost: \$121/MWh (see table below)

	<b>Capacity Factor</b>	<b>Rate \$/MWh</b>	<b>Cost/MWh \$/MWh</b>
OCGT	15%	\$105	\$35
Wind	30%	\$90	\$60
OCGT Back-up for wind	30%	\$39	\$26
Total Wind and OCGT	45%		\$121

The cost of CCGT is \$54/MWh. The cost of wind including back-up is about \$121/MWh. The difference is \$67/MWh. This is the cost per MWh to avoid some CO2 emissions.

Analysis of a report by the UK Royal Academy of Engineering “The Costs of Generating Electricity”<sup>5</sup> gives similar figures.

	<b>UK p/kWh</b>	<b>A\$/MWh</b>
CCGT	2.2	\$51
OCGT	3.2	\$74
Wind	3.7	\$86
back up	1.7	\$40
Wind with back up	5.4	\$126

<sup>5</sup> [http://www.raeng.org.uk/news/publications/list/reports/Cost\\_Generation\\_Commentary.pdf](http://www.raeng.org.uk/news/publications/list/reports/Cost_Generation_Commentary.pdf)

## **Greenhouse Emissions per MWh**

The University of Sydney's Integrated Sustainability Analysis report<sup>6</sup> provides the greenhouse gas emission intensity factors for wind in columns 2 and 3 below. The fourth column (for 30% capacity factor and 20 year economic life) is calculated by factoring from columns 2 and 3.

Capacity Factor	31.2%	23.1%	30%
Economic life (yr)	25	20	20
Emissions Factor (t CO <sub>2</sub> -e/MWh)	0.021	0.040	0.027

Source: [http://www.pmc.gov.au/umpner/docs/commissioned/ISA\\_report.pdf](http://www.pmc.gov.au/umpner/docs/commissioned/ISA_report.pdf)

The greenhouse gas emission factors for gas turbines from the same report are:

<b>Generator technology</b>	<b>OCGT</b>	<b>CCGT</b>
Greenhouse gas emissions factor (t CO <sub>2</sub> -e/MWh)	0.751	0.577

## **Emissions Avoided per MWh**

If CCGT generated the power, the emissions would be 0.577 t CO<sub>2</sub>-e/MWh.

If Wind and OCGT generate the same amount of power, the emissions would be 0.519 t CO<sub>2</sub>-e/MWh (see table below).

	<b>CF</b>	<b>Factor t CO<sub>2</sub>e/MWh</b>	<b>Emissions t CO<sub>2</sub>e/MWh</b>
OCGT	15%	0.751	0.250
Wind	30%	0.027	0.018
Back-up for wind (assumed 50% of OCGT)	30%	0.376	0.250
Total Wind and OCGT	45%		0.519

Therefore, the emissions avoided by wind are:  $0.577 - 0.519 = 0.058$  t CO<sub>2</sub>-e/MWh

We can compare this figure with figures derived from two other sources.

First, the "South Australian Wind Power Study"<sup>7</sup> provides an upper bound figure. This study modelled the effect of introducing wind generation in South Australia on the amount of fossil fuel generation and the long run and short run marginal costs of generation across the whole National Electricity Market. The study also modelled the amount of greenhouse gas emissions saved, but points out that several factors are not included in the analyses. The study determined the amount of CO<sub>2</sub> emissions avoided by wind, excluding emissions from providing back up, is about 0.5 t CO<sub>2</sub>-e/MWh. This can be considered as an upper bound, because the modelling does not consider:

- Emissions from maintaining 'spinning reserve' with back up generators;

<sup>6</sup> [http://www.pmc.gov.au/umpner/docs/commissioned/ISA\\_report.pdf](http://www.pmc.gov.au/umpner/docs/commissioned/ISA_report.pdf)

<sup>7</sup> "South Australia Wind Power Study" by Electricity Supply Industry Planning Council, March 2003.

- Emissions from powering up and running down the generators;
- Emissions from coal power stations when they are required to reduce power by venting steam (while they continue to burn coal and emit CO2 at their full rate);
- Emissions from generating the energy to provide reactive and feed-in power for the wind generators;
- Emissions from building, operating and maintaining the strengthened grid needed to support the distributed wind power generators;
- Emissions from the additional work required by the distributors;
- Emissions from coal power stations pumping water to pumped storage that then has to be used for rapid response back-up, for extra ‘spinning reserve’ and for stabilising the grid because of the variable power from wind turbines;
- The hydro energy resource on mainland Australia is limited and insufficient to provide for even our peak load energy needs. Any hydro energy used as back up for wind power must be replaced with OCGT generation. In effect, any hydro energy used for back up for wind has the same emissions as OCGT running as back up for wind.

The second source for comparison is the Royal Academy of Engineering report “The Cost of Generating Electricity”<sup>8</sup>. We can calculate the amount of emissions avoided by wind with back up from the information provided in the report.<sup>9</sup>

	Generation cost (UK p/kWh)			Emissions kg CO2e / kWh
	Carbon tax £0 / t CO2-e	Carbon tax £30 / t CO2-e	Difference	
CCGT	2.2	3.4	1.2	0.400 <sup>10</sup>
OCGT	3.2	4.8	1.6	0.533
Wind	3.7	3.7	0	0.027
back up	1.7	1.7	0	0.283 <sup>11</sup>
Wind with back up	5.4	5.4	0	0.310
<b>Emissions avoided</b>				<b>0.090</b>

So, we have three values for the amount of greenhouse gas emissions avoided by wind generation per MWh.

Basis of estimate	t CO2 avoided /MWh
Wind with OCGT back up displacing CCGT	0.058
Wind, excluding back up (SA Wind Power Study) <sup>12</sup>	0.5
Wind including back up (Royal Academy of Engineering, UK)	0.09

<sup>8</sup> [http://www.raeng.org.uk/news/publications/list/reports/Cost\\_Generation\\_Commentary.pdf](http://www.raeng.org.uk/news/publications/list/reports/Cost_Generation_Commentary.pdf)

<sup>9</sup> Using cost data from the Royal Academy of Engineering report (with and without a carbon tax), we can infer the emissions per kWh factor they used by taking the difference in cost per tonne CO2 and dividing it by the carbon tax cost per tonne CO2 (first two rows). Emissions for wind, back-up and wind with back-up are taken from the previous page. Emissions avoided (last row) are calculated by CCGT emissions minus emissions from wind with back-up.

<sup>10</sup> calculated as: Difference converted from p to £, divided by carbon tax, converted from t to kg

<sup>11</sup> calculated as: emissions from OCGT x cost of back-up / cost of OCGT

<sup>12</sup> “South Australia Wind Power Study” by Electricity Supply Industry Planning Council, March 2003.

### ***Cost of emissions avoided per MWh***

The cost of emissions avoided by wind power can be calculated from the figures in the preceding sections. The cost of emission avoided by wind is the cost of substituting wind power plus OCGT back-up for CCGT. We have three figures for the amount of emissions avoided. The higher emissions avoided (lower avoidance cost) is calculated from the results of a modelling analysis which does not include the emissions from back up. The two low figures for emissions avoided (higher avoidance cost) do include an allowance for the emissions from back up. The first is a simple analysis. The other is from a sophisticated study by the UK Royal Academy of Engineering.

Cost per MWh to substitute Wind with back-up for CCGT (\$/MWh)	\$67	\$67	\$74
Emissions avoided (t CO <sub>2</sub> -e/MWh)	0.058	0.5	0.09
Cost of emissions avoided (\$t CO <sub>2</sub> -e avoided)	\$1,149	\$134	\$830


All three figures for the cost of emissions avoided by Wind power are high compared with alternatives.

### ***Comparison with Other Options to Reduce Emissions from Electricity Generation***

Figure 4 shows the cost of avoiding emission, and the amount of emissions avoided per MWh, by some new base load electricity generating technologies. Wind contributes to generating for shoulder (or non-continuous) power rather than base load so the figures are not directly comparable. But the figures do indicate that wind power is a costly way to reduce CO<sub>2</sub> emissions (i.e., \$134 to \$1149 per tonne CO<sub>2</sub>-e avoided), and that the amount of emissions avoided by wind is negligible.

Nuclear power avoids the most emissions per MWh and is the least cost for doing so at about \$22 per tonne of CO<sub>2</sub> avoided (Figure 4).

Figure 4 - Projected cost of electricity, amount of emissions avoided and avoidance cost per MWh for future base load electricity generation technologies.  
 Source: calculated from the reports by EPRI<sup>13</sup> and University of Sydney Integrated Sustainability Analysis<sup>14</sup>.

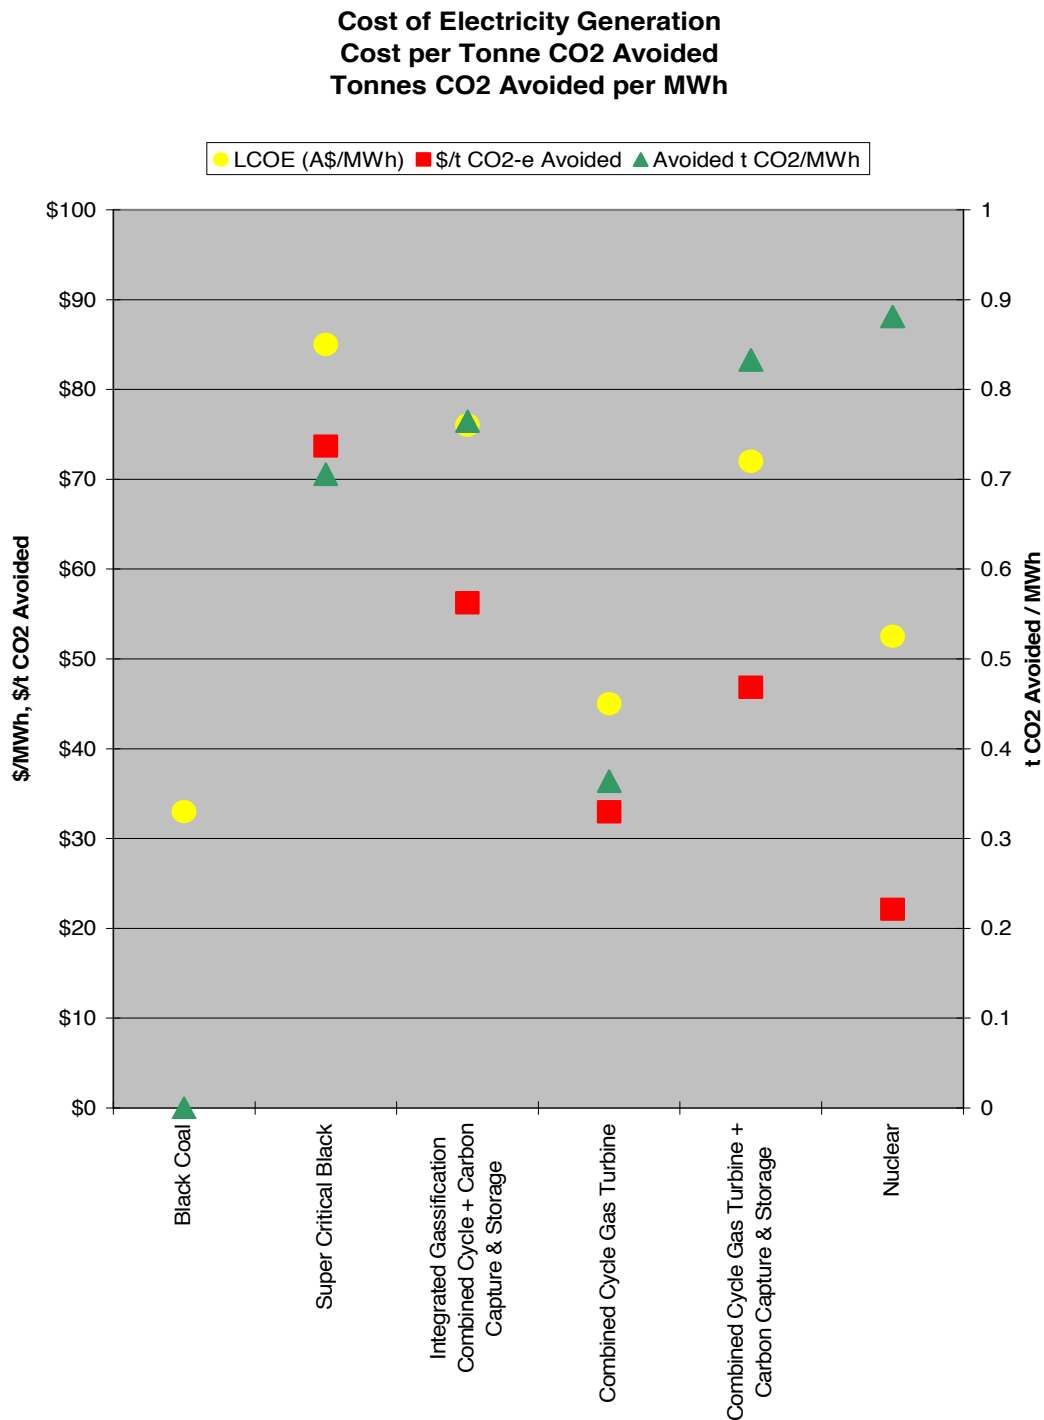

<sup>13</sup> [http://www.pmc.gov.au/umpner/docs/commissioned/EPRI\\_report.pdf](http://www.pmc.gov.au/umpner/docs/commissioned/EPRI_report.pdf)

<sup>14</sup> [http://www.pmc.gov.au/umpner/docs/commissioned/ISA\\_report.pdf](http://www.pmc.gov.au/umpner/docs/commissioned/ISA_report.pdf)

The table below compares some technology options for reducing emissions. The technologies are ordered from highest to lowest cost of avoiding emissions (column 3).

	Emissions (t CO <sub>2</sub> -e / MWh	Emissions Avoided (t CO <sub>2</sub> -e avoided / MWh	Cost of Emissions avoided (\$/t CO <sub>2</sub> -e avoided)
Wind (including back up generation) (Aus) <sup>15</sup>	0.519	0.058	\$1149
Wind (including back up generation) (UK)	0.310	0.090	\$830
'Clean Coal' (IGCC + CCS)	0.176	0.765	\$56
Combined Cycle Gas Turbine + CCS	0.108	0.833	\$47
Combined Cycle Gas Turbine	0.577	0.364	\$33
Nuclear	0.060	0.880	\$22

The table shows:

1. Wind power is the highest cost and nuclear the lowest cost for avoiding emissions (by a factor of about 50) (Column 3);
2. Wind power does not meet the Clean Energy Targets'<sup>16</sup> 200 kg/MWh test (Column 1);
3. Only nuclear and the fossil fuel technologies with carbon capture and storage meet the '200 kg/MWh test' (Column 1);
4. Only nuclear and the fossil fuel technologies with carbon capture and storage can make substantial reductions in emissions - i.e., can avoid more than 750 kg/CO<sub>2</sub>-e/MWh (Column 2). To put this in perspective, 750 kg/CO<sub>2</sub>-e/MWh is about 75% of the emissions from conventional coal fired generation. Coal fired generation produces about 76% of Australia's electricity and 89% of electricity's greenhouse gas emissions.

## Discussion

The results are sensitive to the input parameters (capacity factors, emissions per MWh, costs per MWh, and the cost and emissions from back-up).

The capacity factor for wind generation in NSW should be less than the 30% used in this analysis (for example Crookwell 14.7% over 5 years and Blayney 22%).

<sup>15</sup> For wind back up generation the figures are:

Wind (excluding back up generation) (Aus)	0.027	0.500	\$134
---	-------	-------	-------

<sup>16</sup> The Federal Government recently announced national Clean Energy Targets to replace the state based renewable energy and emissions reductions schemes. The new national Clean Energy Target, requires that 30,000 GWh each year must come from low emissions sources by 2020. Low emission sources are those technologies that emit less than 200 kg of greenhouse gases per MWh of electricity generated.

These calculations suggest that wind generation saves little greenhouse gas emissions when the emissions from the back-up are taken into account.

Wind power, with emissions and cost of back-up generation properly attributed, avoids 0.058 to 0.09 t CO<sub>2</sub>-e/MWh compared with about 0.88 t CO<sub>2</sub>-e/MWh avoided by nuclear. The cost to avoid 1 tonne of CO<sub>2</sub>-e per MWh is \$830 to \$1149 with wind power compared with \$22 with nuclear power. If the emissions and cost of back up generation are ignored then wind power avoids about 0.5 t CO<sub>2</sub>-e/MWh at a cost of about \$134/t CO<sub>2</sub>-e avoided. Even if the costs of and emissions from back up generation are ignored, wind is still over six times more costly than nuclear as a way to avoid emissions.

A single 1000 MW nuclear plant (normally we would have four to eight reactors together in a single power station) would avoid 6.9 million tonnes of CO<sub>2</sub> equivalent per year. Five hundred 2 MW wind turbines (total 1000 MW) would avoid 0.15 to 1.3 million tonnes per year – just 2 to 20% as much as the same amount of nuclear capacity. When we take into account that we could have up to 80% of our electricity supplied by nuclear (as France has), but only a few percent can be supplied by wind, we can see that nuclear can make a major contribution to cutting greenhouse emissions, but wind a negligible contribution and at much higher cost.

### **Conclusions:**

1. Wind power does not avoid significant amounts of greenhouse gas emissions.
2. Wind power is a very high cost way to avoid greenhouse gas emissions.
3. Wind power, even with high capacity penetration, can not make a significant contribution to reducing greenhouse gas emissions.

### **References**

<http://www.esaa.com.au/images/stories//energyandemissionsstudystage2.pdf>

[http://www.pmc.gov.au/umpner/docs/commissioned/EPRI\\_report.pdf](http://www.pmc.gov.au/umpner/docs/commissioned/EPRI_report.pdf)

[http://www.pmc.gov.au/umpner/docs/commissioned/ISA\\_report.pdf](http://www.pmc.gov.au/umpner/docs/commissioned/ISA_report.pdf)

<http://www.greenhouse.gov.au/workbook/pubs/workbook2006.pdf>

“The Long Run Marginal Cost of Electricity Generation in New South Wales; A report to the Independent Pricing and Regulatory Tribunal”, February 2004. By Intelligent Energy Systems.



“South Australia Wind Power Study” by Electricity Supply Industry Planning Council, March 2003.

“Planning Council Wind Report to ESCOSA”, by ESIPC, April 2005.

“Review of Impacts of High Wind Penetration in Electricity Networks” Client ESIPC, by Garrard Hassan Pacific Pty Ltd, March 2005.

“Dealing with Renewable Energy Sources in the Australian Energy Market Place; Integration of Wind Generation into the NEM”, by Dr Charlie Macaulay, NEMCO 2006.

“Market Design Review – Survey of Market Performance”. NZ Electricity Commission. 2006.

“Electricity Generation from Renewable Energy Sources – Options to Provide Incentives at Least Cost to the Economy” Prepared for Greenhouse Policy Coalition, NZ, by ACIL Tasman, September 2006.

“Annual Report on US Wind Power Installation, Cost and Performance Trends; 2006”

<http://www.greenhouse.gov.au/renewable/aest/pubs/aest-review.pdf>

<http://www.greenhouse.gov.au/inventory/enduse/pubs/vol1-fuelcycle.pdf>

[http://www.tyndall.ac.uk/research/theme2/final\\_reports/t2\\_24.pdf](http://www.tyndall.ac.uk/research/theme2/final_reports/t2_24.pdf)

[http://www.raeng.org.uk/news/publications/list/reports/Cost\\_Generation\\_Commentary.pdf](http://www.raeng.org.uk/news/publications/list/reports/Cost_Generation_Commentary.pdf)

“Driving Investment in Renewable Energy in Victoria ; Options for a Victorian market-based measure”; Submission by Origin Energy in response to the Issues Paper released by Department of Infrastructure and Department of Sustainability and Environment, December 2005.

### ***About the Author***

Peter Lang is a retired engineer with 40 years experience on a wide range of energy projects throughout the world, including managing energy R&D and providing policy advice for government and opposition. His experience includes: coal, oil, gas, hydro, geothermal, nuclear power plants and nuclear waste disposal (6.5 years managing a component of the Canadian Nuclear Fuel Waste Management Program).